

### Introduction

Gable spandrel panels can be used as a continuation of the internal skin of masonry cavity blockwork. Where this occurs, the panels must be designed to resist wind loadings acting on the end walls and also loads applied by the claddings. Some of the key warranty risk areas associated with gable spandrel panels will be highlighted in this article.

It is important that all spandrel panels, supporting structures and fixings, are designed by an Engineer to withstand all applied vertical and horizontal loads, on a site by site basis and not a generic solution

Please note, erection procedures and temporary restraint requirements are outside the scope of this guidance.

### Providing a drained and vented cavity

Gable spandrel panels are essentially a form of timber frame construction, and as such, they must incorporate a sheathing board, breather membrane and maintain a minimum of a 50mm clear cavity. Full fill cavity insulation will not be acceptable for warranty as this prevents the spandrel panel frame from being able to dry out. The stud positions should be clearly marked on the breather membrane to assist in correct installation and positioning of wall ties.

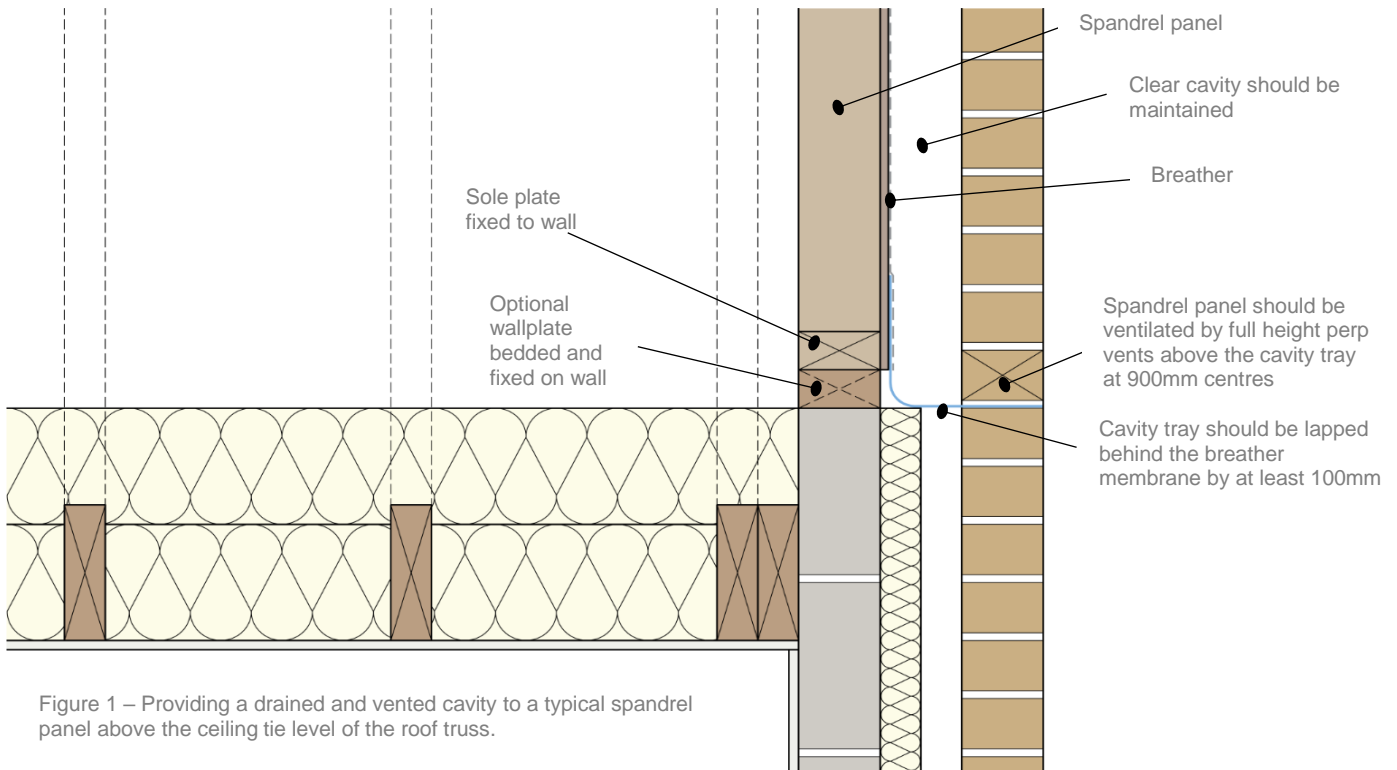


Figure 1 – Providing a drained and vented cavity to a typical spandrel panel above the ceiling tie level of the roof truss.

In a masonry cavity wall where blown full fill insulation is being used – below the Spandrel panel, there should be a way of insuring that the insulation does not deform the cavity tray or spread into the spandrel panel cavity frame area by incorporating a non-deformable cavity closure or ridged preformed cavity trays.

## Lateral restraint

Spandrel panels require lateral restraint at rafter level and along the base of the panel (see figures 2 and 3). Lateral restraint could be provided by:


- Timber members (e.g. the longitudinal bracing secured to the spandrel with timber ledgers/noggins), fixed into at least two studs within the panels (see figure 4)
- Metal restraint straps fixed to the panel and to noggins, or timber bracing fixed across the trusses (see figure 2).

Gable spandrel panels must resist wind loads acting on the gable end walls and loads transferred from elsewhere e.g. from the roof structure, bracing etc. These loads are transmitted through the panel from the roof structure, bracing etc. via lateral restraints.

The restraint of the panels, should be designed by an Engineer to withstand all applied vertical and horizontal loads, on a site by site basis to suit the structural requirements of each project. The design and supporting calculations should be provided to the Warranty Surveyor.

Other points to consider:

- Intermediate restraint may also be necessary for larger panels
- Restraint straps should be located at a minimum 2m centres and should pass at least 3 trusses
- Restraint strap to be fixed to a panel stud, with fixings capable of resisting a minimum 8 kN force (based on restraint straps at maximum centres).
- A timber blocking piece is typically required between the truss and spandrel panel

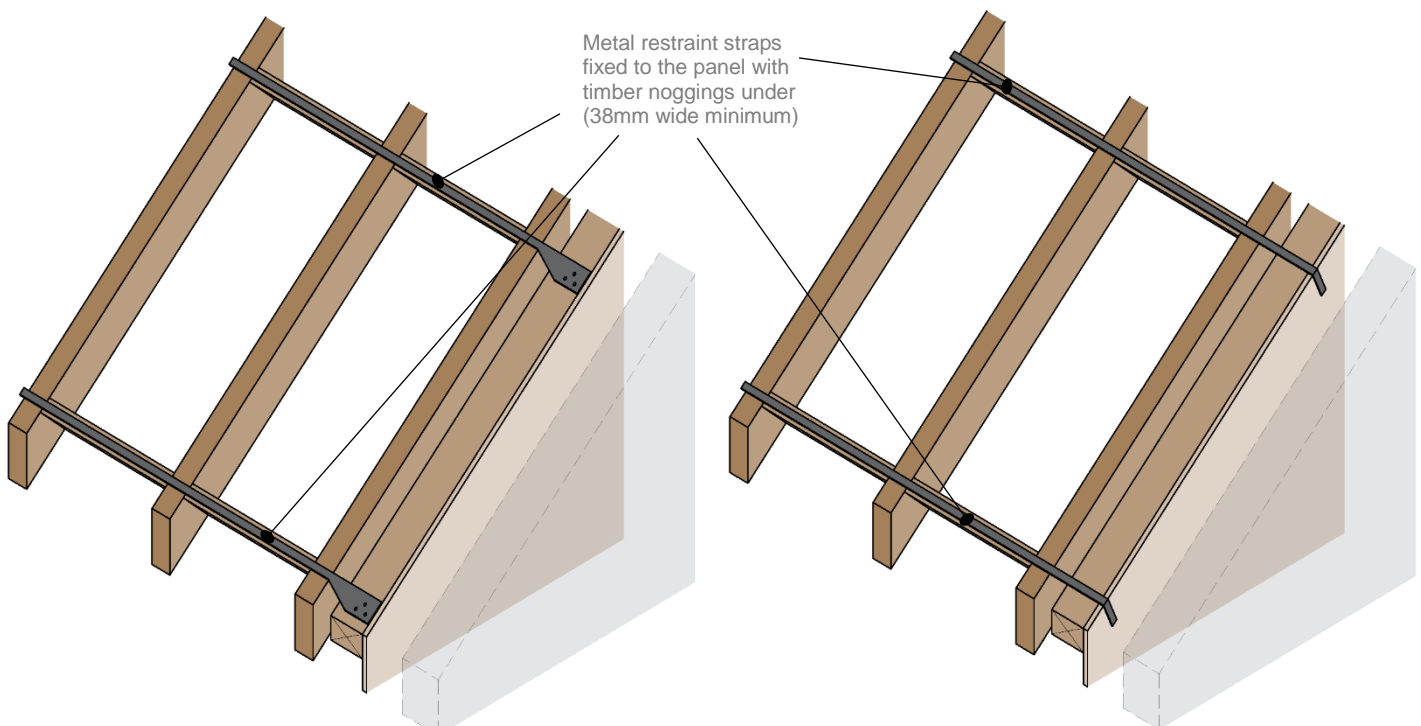

## Technical Update: Key risk areas for gable spandrel panels

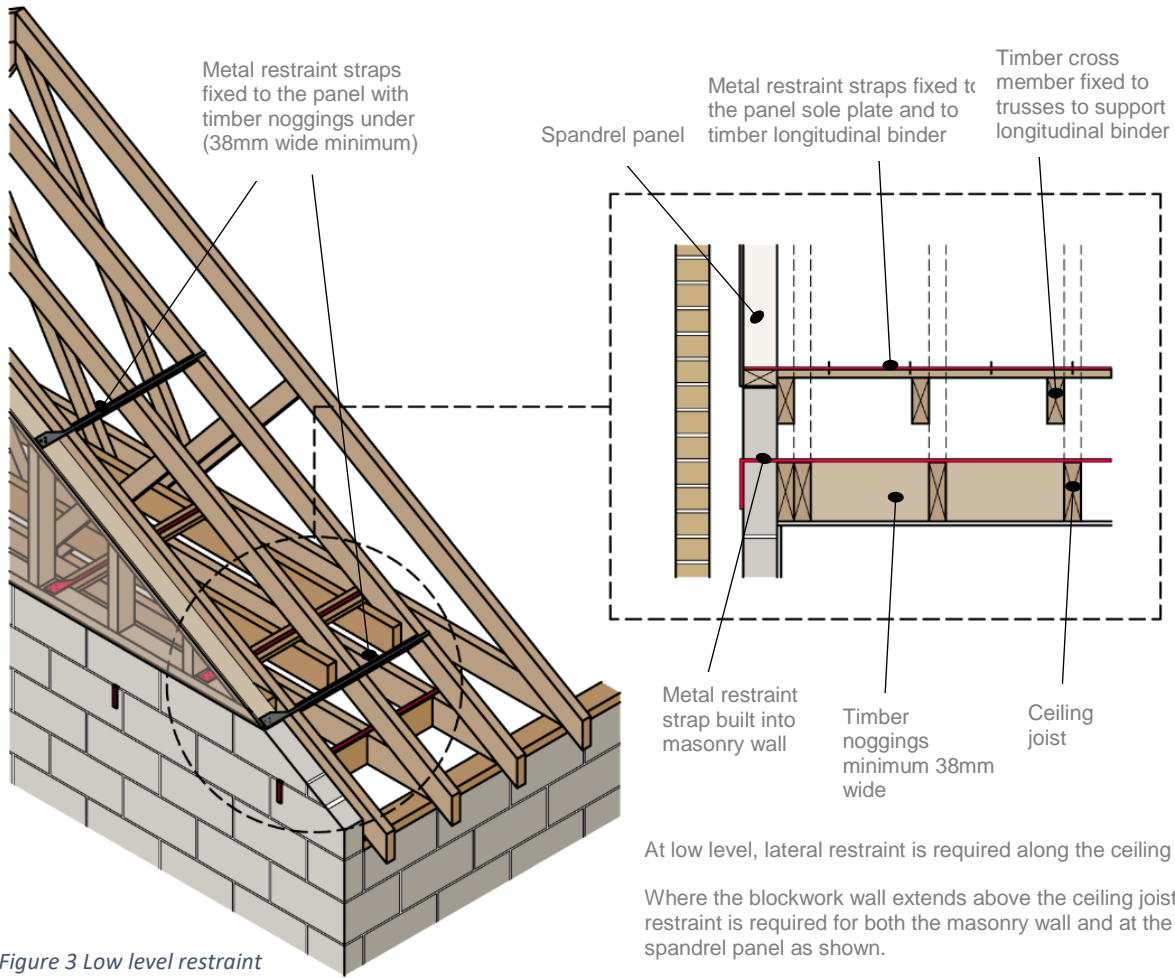


Figure 3 Low level restraint


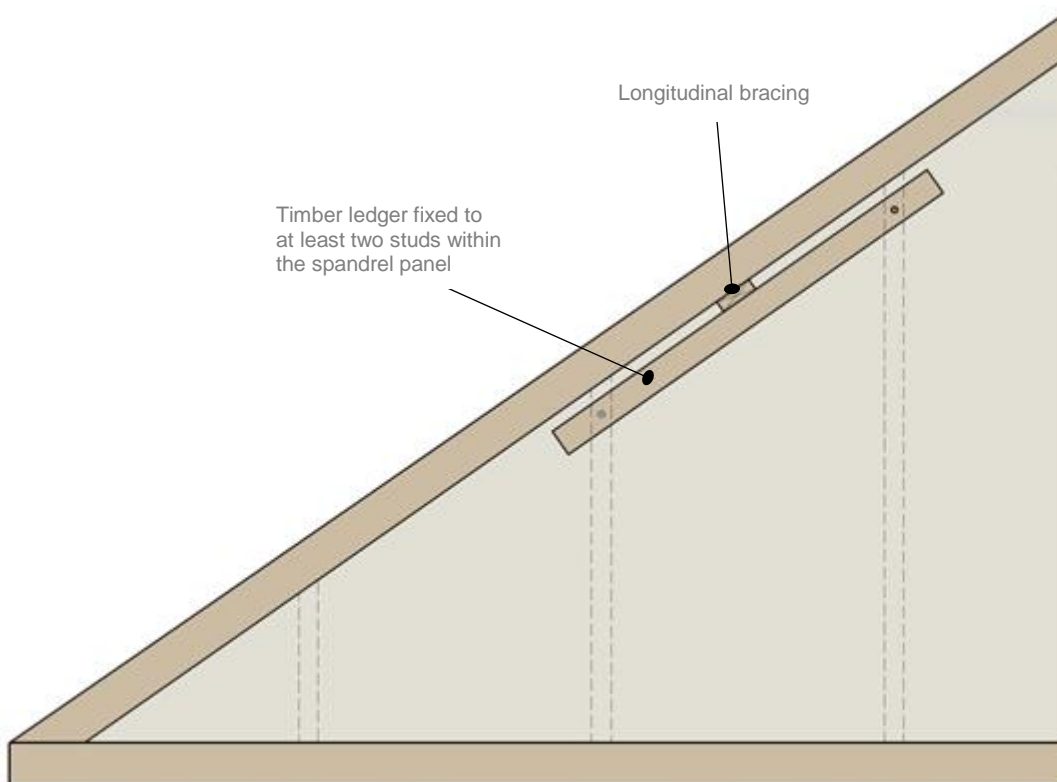


Figure 4 Lateral restraint provided by longitudinal bracing secured to the spandrel with timber ledgers/noggings, fixed into at least two studs within the panels

### Wall tie locations

Wall ties between the spandrel panel and brick or block outer leaf should have the ties fixed into the timber vertical studs of the spandrel panel. The spacing of wall ties should be increased at the top of the wall and where a potential slip plane is present (horizontal cavity trays at the base of the spandrel panel).

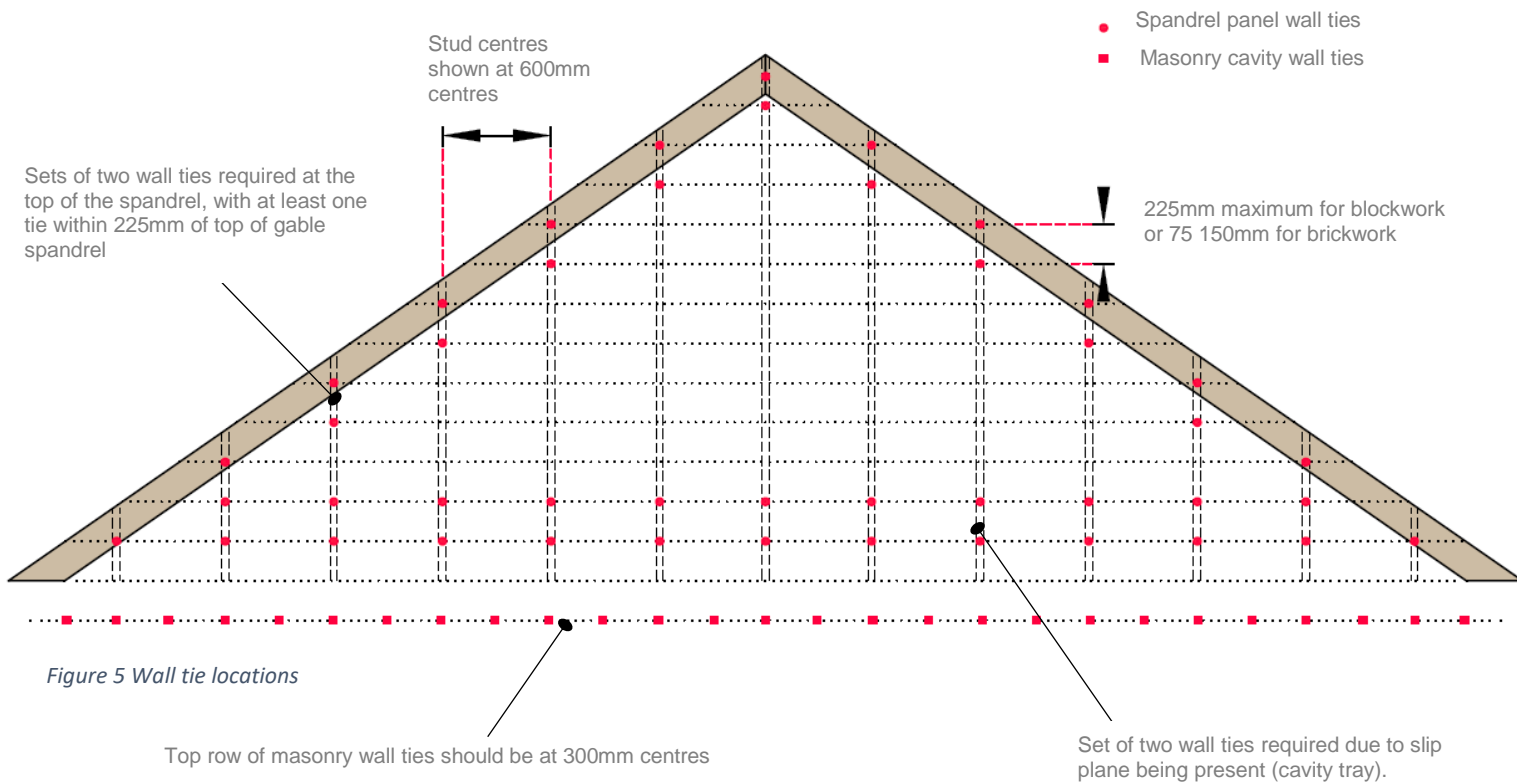

### Notes:

- For the general spandrel panel area, wall ties should be at every stud centre and at 450mm max vertical centres
- The stud positions should be clearly marked on the breather membrane to assist in correct installation of wall ties.
- Block coursing shown in the above image. Wall tie spacings to be determined by the Design Engineer

### Fire spread

Fire spread from gable end spandrel panels is dependent on a number of factors and its distance from relevant boundaries. Advice should be sought from your Building Control Body for further information.

### Warranty stance

As highlighted in this article, there are a number of risk areas when specifying gable end spandrel panels. In all circumstances, it's important to ensure a designer is involved prior to associated works starting on site. It is important that the spandrel panels, supporting structures and fixings, are designed by a suitably experienced Chartered Engineer to withstand all applied vertical and horizontal loads, on a site by site basis.

Read more articles on [InSite](#) and sign up to [receive our blog round-up](#).

Every care was taken to ensure the information in this article was correct at the time of publication (September 2023). Guidance provided does not replace the reader's professional judgement and any construction project should comply with the relevant Building Regulations or applicable technical standards. For the most up to date Premier Guarantee technical guidance please refer to your Risk Management Surveyor and the latest version of the Premier Guarantee [Technical Manual](#).

TS-3633